




Bolted Stringer Understructure for ConCore[®] and All Steel Floor Panels-24". Type 2CF Pedestal crimped for a 3/4 stud.

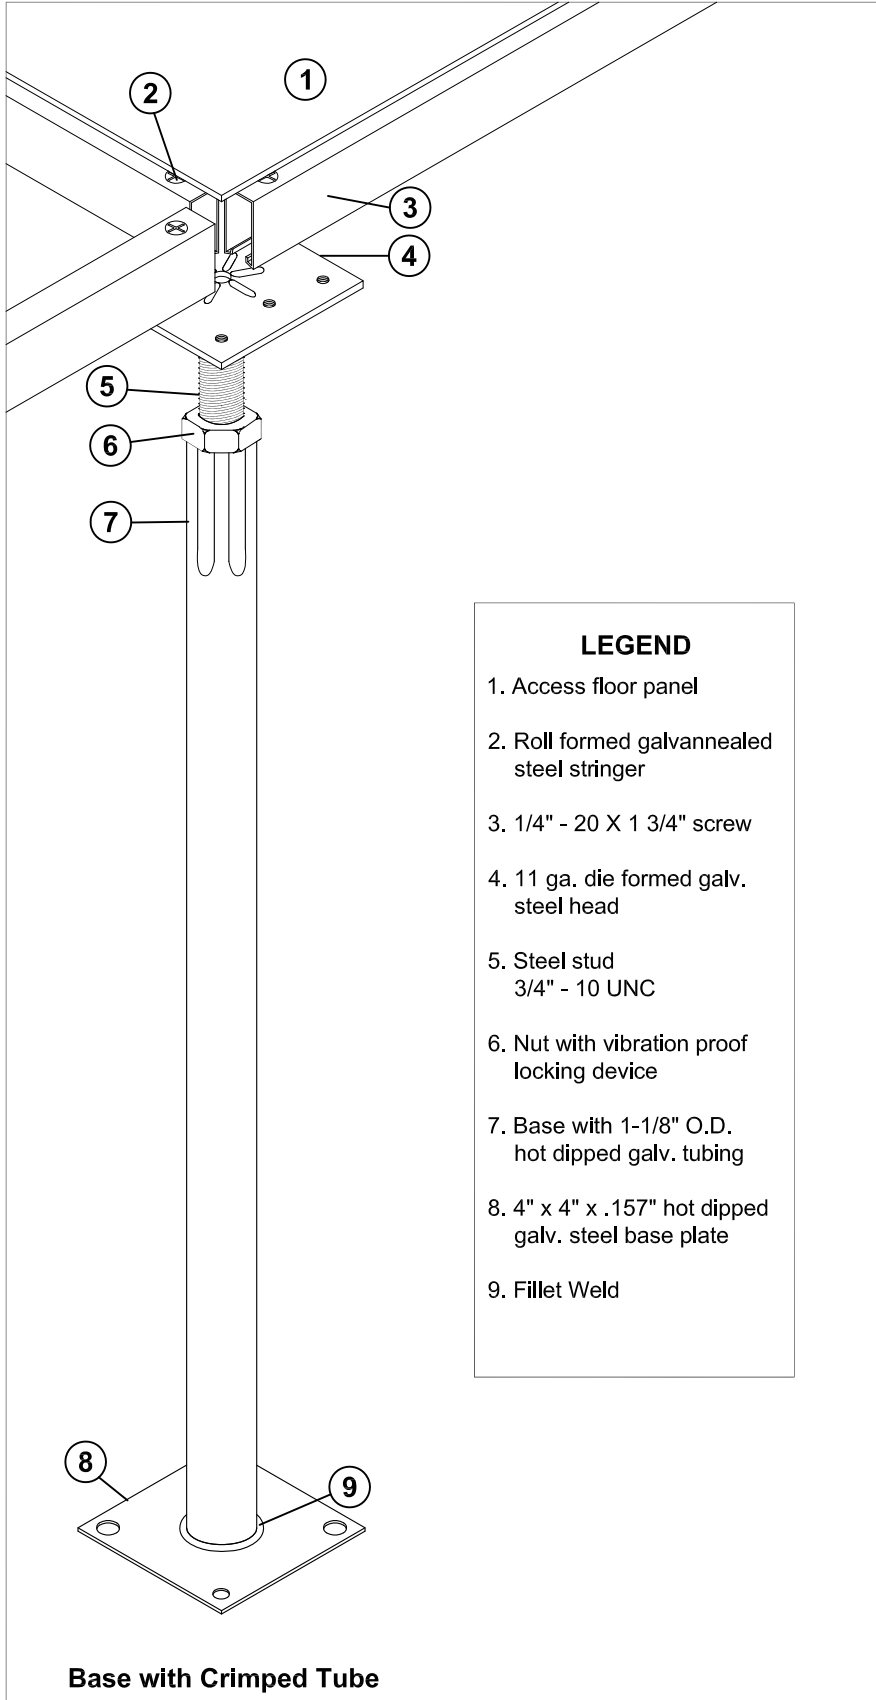

- LEGEND**
1. Access floor panel
 2. Roll formed galvanized steel stringer
 3. 1/4" - 20 X 1 3/4" screw
 4. 11 ga. die formed galv. steel head
 5. Steel stud 3/4" - 10 UNC
 6. Nut with vibration proof locking device
 7. Base with 1-1/8" O.D. hot dipped galv. tubing
 8. 4" x 4" x .157" hot dipped galv. steel base plate
 9. Fillet Weld

PEDESTAL SPECIFICATIONS

Pedestal Assembly

- Assembly up to 36" FFH shall provide an 8,000 lb. axial load without permanent deformation.
- Assembly shall provide a 2" total adjustment.
- All pedestal components and fasteners are completely electro-zinc free.

Pedestal Head


- 11 ga. die formed hot dipped galvanized pedestal head with fillet welded stud and adjustment nut.
- Stringers shall be attached with 1/4" - 20 flat-head screws.
- Pedestal head shall be tapped for engagement of stringer screws.
- Steel stud shall be 3/4" - 10 UNC.
- 3/4" - 10 UNC adjustable nut with corrosion resistant coating
- Stud shall provide an anti-rotation feature when engaged with the pedestal base assembly.

Pedestal Base

- Pedestal tube to be 1-1/8" diameter hot dipped galvanized tubing and shall be reduced to 3/4" inner diameter by swaging or crimping.
- Base plate to be 16 square inch hot dipped galvanized steel and shall have (2) 7/16" diameter holes and (2) 3/16" diameter holes for mechanical fastening applications.

Stringers

- Heavy duty roll formed steel stringer shall be 1-1/4" deep X 3/4" wide and shall withstand 450 lb. mid-span load.
- Stringer shall have galvanized coating to prevent corrosion.
- Stringer grid pattern shall be 2' by 2', 2' by 4', or 4' by 4' basketweave.

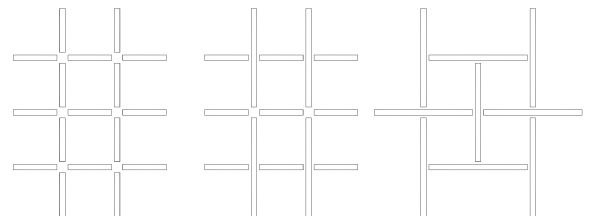

Base with Crimped Tube